



No. of SPACES DEPENDENT ON NUMBER OF BAYS


ELEVATION
DETAIL OF GALV FRAME
SCALE = 1:40

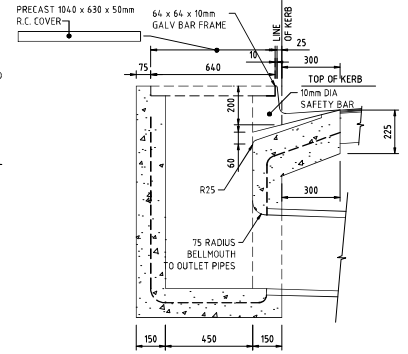


SECTION A-A
SCALE = 1:20




SECTION B-B
SCALE = 1:20

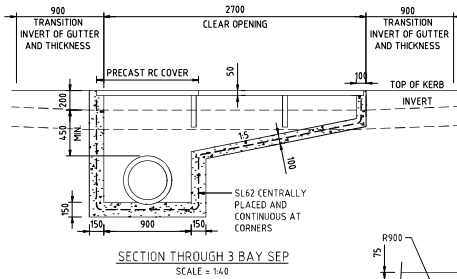

SECTION THROUGH 3 BAY SEP
SCALE = 1:40

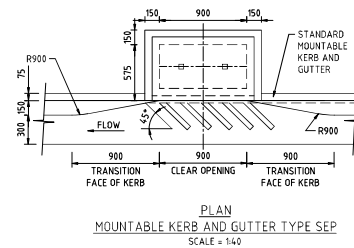

PLAN
MOUNTABLE KERB AND GUTTER TYPE SEP
SCALE = 1:40



ANCHOR DETAIL
NOT TO SCALE

GENERAL NOTES:

1. REFER PROJECT DRAWINGS FOR ACTUAL PIPE LOCATION. ARRANGEMENTS SHOWN IN THIS DRG ARE DIAGRAMMATIC ONLY.
2. USE M5 CONCRETE TO AS 1319 AND AS 3600 FOR ANY PATCHING OF PITS USE MORTAR MIXED WITH 'CONCRETE' OR SIMILAR.
3. FIBRECRETE MAY BE USED HOWEVER IF USED WITHOUT SEPARATE WALL REINFORCEMENT THEN ENGINEERING OF WALL THICKNESS IS REQUIRED.
4. ALTERNATIVE - GATIC PROPRIETARY OR APPROVED EQUIVALENT FRAMES GRATES AND COVERS MAY BE USED, IF USED THEY SHALL BE OF APPROPRIATE LOADING CLASS FOR THEIR SITUATION AND INSTALLED IN ACCORDANCE WITH MANUFACTURES INSTRUCTIONS.
5. ALL STEELWORK TO BE CLEANED AFTER FABRICATION & HOT DIPPED GALVANISED.
6. SAG PITS DO NOT REQUIRE DEFLECTORS.
7. TRANSITION TO LAYBACK KERB
SAG PITS - 1m EITHER SIDE OF PIT
PITS ON GRADE - STRAIGHT 3m EITHER SIDE OF PIT
PITS ON GRADE - ON CURVE 1.5m EITHER SIDE OF PIT
8. PROVIDE STABILISED BACKFILL ADJACENT TO ALL DRAINAGE STRUCTURES IN ACCORDANCE WITH LITCHFIELD COUNCIL'S STANDARD.

ADMT	DESCRIPTION	DATE	APPR17	RC	AUTH



PO Box 446, Humpy Doo NT 0836
PH 08 8983 0600 FAX: 08 8983 1165

DRAWN
AURECON

STANDARD DRAWING
STANDARD SIDE ENTRY PITS
TYPE 1

SCALE NOT TO SCALE	
DRAWING No. LC-302	AMDT. 0